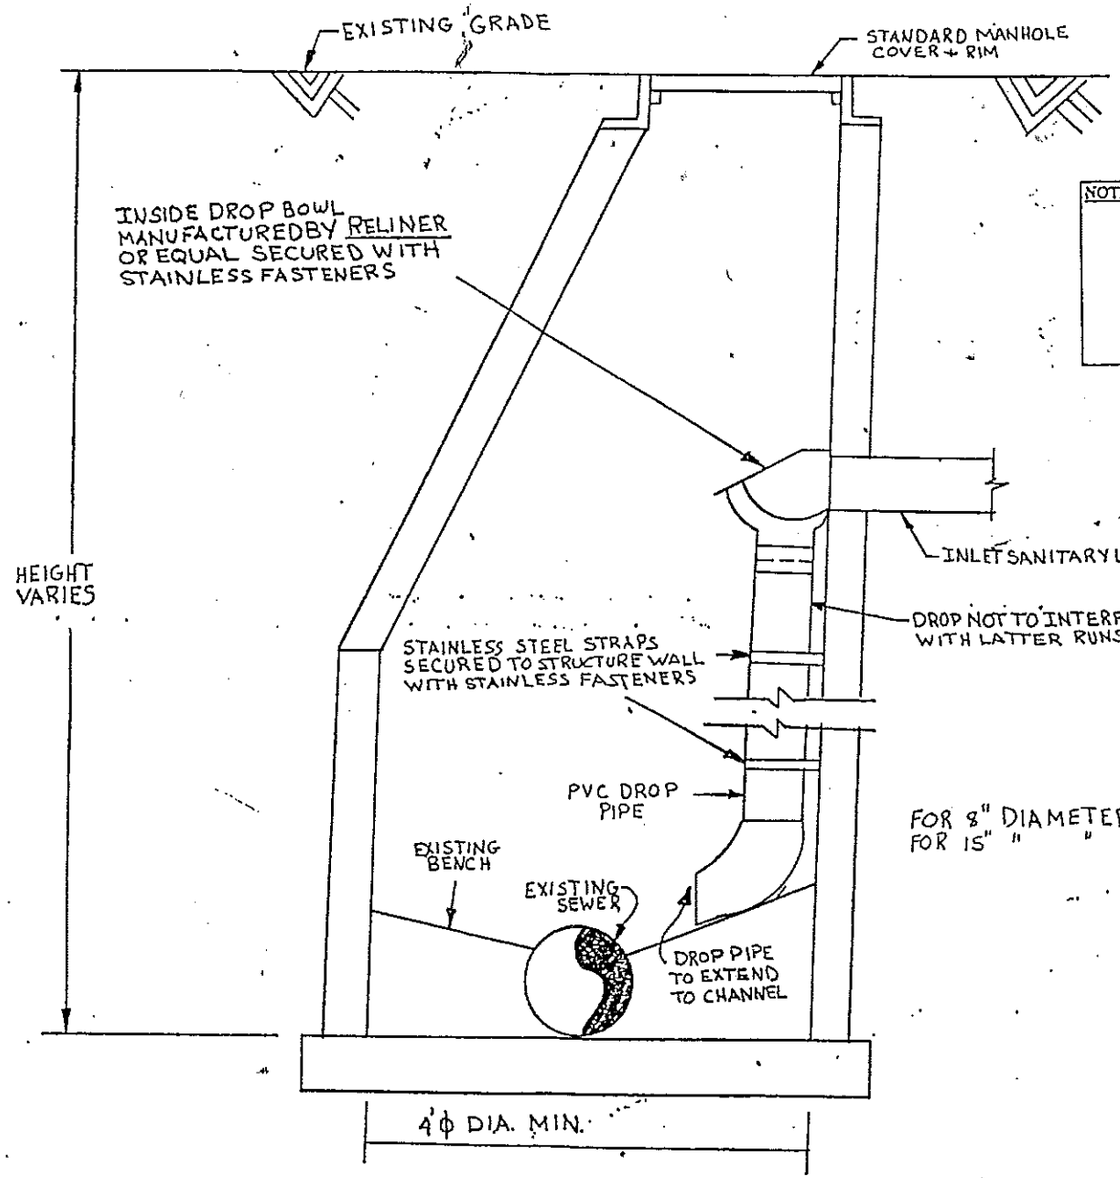

NOTES:

1. SLOPE BENCH TO CHANNEL
2. CHANNEL DEPTH MUST BE 80% OF SEWER MAIN DIAMETER
3. LADDER RUNGS AND PIPING SHOULD BE PLACED TO AVOID CONFLICT WITH EACH OTHER
4. FOUNDATION AS PER STANDARD MANHOLE DETAIL

FOR 8" DIAMETER INLET PIPE USE 6" SDR DROP PIPE
FOR 15" " " " " USE 8" SDR DROP PIPE.

JERSEY CITY SEWERAGE AUTHORITY - DETAIL #3

DROP MANHOLE DETAIL